

Product Details and Certifications

Cross Reference RA Part Number: PN-D13258

 Product: **140G-NRP-E12**

Description: 1200A Rating Plug

CIRCUIT BREAKER DATA

Bulletin Number	140G Molded Case Circuit Breaker Accessories
Number of Poles	3 Poles
Frame Size	N frame
Rated Current(A)	1200 A

ACCESSORY ITEMS

Rating Plug	1200A Rating Plug
-------------	-------------------

Maintenance Mode (MM)

Maintenance Mode (MM) offers a preset set of protection parameters. MM allows systems testing when the molded case circuit breaker is energized or ON. This feature is a manual adjustment on the molded case circuit breaker, via a DIP switch. The following table illustrates the preset values for Maintenance Mode.

Rated Current I_n [A]	L		S		I	G		MM
	$I_1=1 \times I_n$	$t_1=MAX \text{ sec.}$	$I_2=OFF$	$t_2=OFF \text{ sec.}$	$I_3=4 \times I_n$	$I_4=OFF$	$t_4=OFF \text{ sec.}$	$I_5=2.5 \times I_n$
1200	480...1200	3...144	—	—	—	—	—	1800...4800

Molded Case Switch — UL489‡

Rated Current I_n [A]	Magnetic Trip [A] I_m	Cat. No.	
		3 Poles	4 Poles
1200	20 000	140G-N6S3-E12	140G-N6S4-E12



‡ Does not provide overcurrent protection; may open above 20,000 A.

Trip Units, Electronic LSI (Long, Short, Instantaneous), LSIG (Long, Short, Instantaneous, Ground Fault), LSIG-MM (Long, Short, Instantaneous, Ground Fault - Maintenance Mode)§

Rated Current I_n [A]	Protection Type	Cat. No.
		3 Poles
1200	H (LSI)	140G-NTH-E12
1200	I (LSIG)	140G-NTI-E12
1200	K (LSIG-MM)	140G-NTK-E12



§ Supplied installed with each MCCB. Cat. Nos. listed are replacement parts.

Rating Plugs

Rated Current I_n [A]	Cat. No.
400	140G-NRP-D40
600	140G-NRP-D60
800	140G-NRP-D80
1000	140G-NRP-E10
1200	140G-NRP-E12
1250 ★	140G-NRP-E125




★ IEC only.

Bulletin 140G-N, -NS

Available Rating Plugs (I_n): 400 A, 800 A, 1000 A, 1200 A, 1250 A (IEC)

LSI

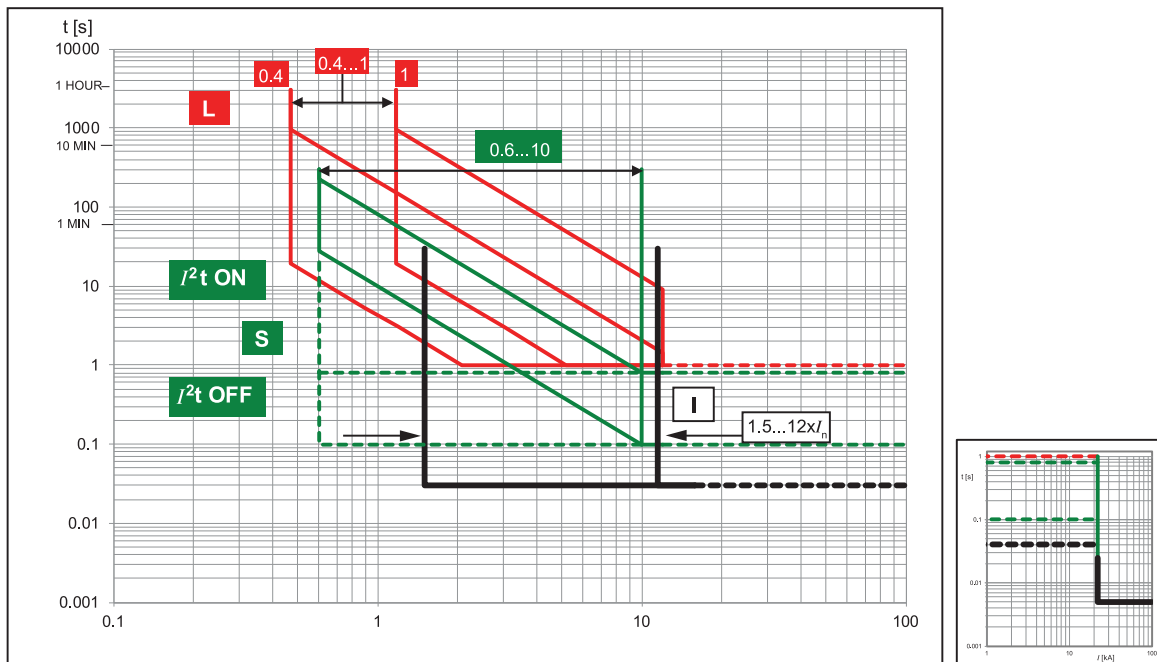

Protection	Disable	Trip Threshold	Trip Time	Trip Threshold Tolerance ⁽²⁾	Trip Time Tolerance ⁽²⁾
L ($t=k/I$)		$I_1=0.4-0.44-0.48-0.52\dots 1 \times I_n$	$t_1=3-6-12-18 \text{ s}^{(1)} @ 6I_1$	Release between 1.05 and 1.2 $\times I_1$	$\pm 10\% I_f \leq 6 \times I_n$
S ($t=k$)	✓	$I_2=0.6-0.8-1.2-1.8-2.4-3-3.6-4.2-5-5.8-6.6-7.4-8.2-9-10 \times I_n$	with $I > I_2$ $t_2=0.1-0.25-0.5-0.8 \text{ s}$	$\pm 7\% I_f \leq 6 \times I_n$ $\pm 10\% I_f > 6 \times I_n$	The best of: $\pm 10\%$ or $\pm 40 \text{ ms}$
S ($t=k/I$)	✓	$I_2=0.6-0.8-1.2-1.8-2.4-3-3.6-4.2-5-5.8-6.6-7.4-8.2-9-10 \times I_n$	$I=10 \times I_n$ $t_2=0.1-0.25-0.5-0.8 \text{ s}$	$\pm 7\% I_f \leq 6 \times I_n$ $\pm 10\% I_f > 6 \times I_n$	$\pm 15\% I_f \leq 6 \times I_n$ $\pm 20\% I_f > 6 \times I_n$
I ($t=k$)	✓	$I_3=1.5-2.5-3-4-4.5-5-5.5-6.5-7-7.5-8-9-9.5-10.5-12 \times I_n$	$\leq 30 \text{ ms}$	$\pm 10\%$	

Notes:

- The minimum value of this trip is 1 s regardless of curve type (self-protection)
- These tolerances apply under the following conditions:
 - self-powered relay at full power (without start-up)
 - presence of auxiliary power supply
 - two-phase or three-phase power supply
 - preset trip time $\geq 100 \text{ ms}$
- Curve accuracy applies from $-20 \text{ }^\circ\text{C}$ to $+55 \text{ }^\circ\text{C}$ ambient. For possible continuous ampere derating for ambient above $40 \text{ }^\circ\text{C}$, consult Rockwell Automation.
- The right portion of the curve is determined by the interrupting rating of the circuit breaker.
- Total clearing times shown include the response times of the trip unit, the breaker opening, and the interruption of the current.
- For high fault current levels an additional fixed instantaneous hardware override is provided at 22 kA.

For all cases not covered by the above assumptions, the following tolerance values apply:

Protection	Trip Threshold	Trip Time
L	$1.05 \leq \times I_1 \leq 1.25$	$\pm 20\%$
S	$\pm 10\%$	$\pm 20\%$
I	$\pm 15\%$	$\leq 60 \text{ ms}$
Others	$\pm 20\%$	