



ControlLogix ControlNet Interface Module

Catalog Numbers 1756-CNB and 1756-CNBR

Use These Release Notes

These release notes describe changes in version 5.45 (series D) of the ControlLogix ControlNet Interface Module, catalog numbers 1756-CNB and 1756-CNBR.

Use these notes with your ControlNet Communication Modules in Logix5000 Control Systems user manual, publication CNET-UM001.

Corrected Anomalies

This section describes anomalies corrected in recent firmware revisions.

Anomalies Corrected in Version 5.45

With version 5.45, we corrected this anomaly:

After 497 days of uninterrupted module operation, an internal counter that tracks unscheduled message connection time-outs rolls over. When the rollover occurs, the ControlNet module no longer manages connections as expected, and the module's unconnected buffers eventually become unavailable. You must cycle power or reset the module to restart the counter. The firmware now properly handles the rollover condition.

Anomalies Corrected in Version 5.44

With version 5.44, we corrected these anomalies:

- In certain circumstances where module utilization exceeds 90% and large amounts of unscheduled traffic exists, the network experiences dropped connections. We modified module operation to guarantee proper scheduled connection management.
- In circumstances where module utilization exceeds 90%, the module could incorrectly send scheduled traffic. We modified module operation to guarantee proper scheduled traffic integrity.
- Rarely, an anomaly could occur where the last two bytes of a full 510 byte scheduled MAC frame may be overwritten. A 510 byte MAC frame is the absolute largest achievable scheduled communication from a node in any one Network Update Time (NUT). Refer to Tech Note #G91952649 in Rockwell Automation's Knowledgebase at <http://domino.automation.rockwell.com/applications/kb/RAKB.nsf/>.
- Under certain timing conditions, the 1756-CNB module delays forwarding scheduled data by one Actual Packet Interval (API). We modified the module to handle this condition.

Anomalies Corrected in Version 5.38.40

This version of firmware corrected anomalies related to ControlLogix Redundancy systems. Refer to the ControlLogix Redundancy System Release Notes, publication 1756-RN582, for more information on these fixes.

Anomalies Corrected in Version 5.37

This version of firmware corrected an anomaly where, on rare occasions, scheduled data connections timed out or scheduled data were sent on the wrong ControlNet network update time (NUT). On very rare occasions, this condition could persist for a few NUT times and potentially result in a

connection timeout. Connections would then automatically be re-established by the controller.

The connection timeout and automatic reconnection process yields a connection loss of approximately 3 seconds. During this time, affected I/O connections use their fault states.

Anomalies Corrected in Version 5.36

This version of firmware corrected several System Redundancy related issues with the 1756-CNB and 1756-CNBR. For more information, refer to the ControlLogix System Redundancy Release Notes, publication 1756-RN582, available through the Literature Library at <http://www.rockwellautomation.com/literature>.

Anomalies Corrected in Version 5.32

With version 5.32, we corrected these anomalies:

- We improved the tolerance of the 1756-CNB module to handle delayed 'ACK' messages from third party devices.
- The 1756-CNB module now verifies the node address when doing forward open signature checks.
- We corrected the problem of long recovery times for connections after multiple connection interruptions.
- We corrected the ASSERT in redunob.c error. This typically occurs when the module is in a rack containing a large number of controller, 1756-CNB, or 1756-DNB modules.
- We corrected the problem of the module stuck in 'NET ERR' state.
- We corrected the ASSERT in smacdrv.c line 2042 error.

Anomalies Corrected in Version 5.27

With version 5.27, we corrected these anomalies:

- Accessing a 1756-CNB module as a PLC-5 processor from RSView caused a redlight and exception handlers ASSERT error.
- A 1756-CNB keeper ASSERT error was intermittently seen at node 1 at powerup. The workaround prior to this repair was to change the 1756-CNB node address to something other than one.
- An ASSERT in txlist.c error was intermittently seen on a two-node network when a cable was broken.
- A 1784-PCICS module and a single-media 1756-CNB failed to form a two-node network.
- RSNetWorx would display 'On-Line/Off-Line Mismatch' window continuously even after saving the latest edits successfully.
- A correction was made to the manner in which the CPU utilization was calculated. Previous values were 'high' by as much as 10% in the 10% CPU utilization range. The error reduced linearly by 1% for each 10% increment in CPU utilization and therefore was 'high' by only 1% in the 90% CPU utilization range.

Enhancements to the Firmware

This section describes enhancements in recent firmware revisions.

Enhancements to Version 5.44

- We provided a more descriptive scrolling message for certain fatal error conditions. These include the setting of the node address to zero in any system or to 99 in a redundant system. Also, not being able to communicate with the backplane ASIC or receiving conflicting data from the backplane ASIC will also produce a scrolling error message. For example:

- ADDRESS SWITCHES = 00, ILLEGAL
<file name> <line number>
- ADDRESS SWITCHES = 99, ILLEGAL IN REDUNDANT SYSTEM
<file name> <line number>
- TIMED OUT WAITING FOR SRM TO POWER-UP AND RELEASE
THE BACKPLANE SIGNAL <file name> <line number>
- UNABLE TO COMMUNICATE WITH CHASSIS BACKPLANE
<file name> <line number>
- CONFLICTING RACK SIZE OR SLOT DATA FROM BACKPLANE
ASIC <file name> <line number>
- UNABLE TO COMMUNICATE WITH BACKPLANE ASIC
<file name> <line number>
- SRM RESPONDING TO BACKPLANE PING BUT NOT
REDUNDANCY CONNECTION
<file name> <line number>

Enhancements to Version 5.39

We changed the “n U # #” diagnostic 4-character display to these two displays:

“U c x x” where xx is the number of unconnected client buffers, up to 20, used by the 1756-CNB module. The display is enabled when usage is 80% or greater and turns off when usage drops below 50% of the available buffers.

“U s x x” where xx is the number of unconnected server buffers, up to 20, used by the 1756-CNB module. The display is enabled when usage is 80% or greater and turns off when usage drops below 50% of the available buffers.

Enhancements to Version 5.38.40

- Beginning with this version of the firmware, a sub-minor revision will be added to the revision of the firmware (major rev., minor rev., **sub-minor rev** > i.e., 5.38.40). The sub-minor revision number is added to help better identify and differentiate pre-released products. There should be no change in user behaviors when referencing the firmware revisions of released products. This number is not printed on the product label, however, it is scrolled on the displayed upon module power-up.

TIP



Electronic Keying in RSLogix 5000 keys to the major and minor revisions; the sub-minor revision number cannot be used for keying.

- This version of firmware enhances the rate at which ControlNet network configuration, station status, and error counter information is gathered. With this enhancement, this data will be gathered and updated every 3 seconds to more closely match other system timing such as connection re-establishment.

Enhancements to Version 5.36

This version of the product enhanced the internal RAM memory test to improve memory fault coverage.

Enhancements to Version 5.32

We made these enhancement in version 5.32:

- The 1756-CNBR modules can now be used with the 1756-CNB I/O Configuration entry in RSLogix 5000 under ‘compatible’ keying.
- This version of the product is ControlNet International ‘conformance tested’. All future releases will continue to be CI compliant.

Enhancements to Version 5.27

We made these enhancements in version 5.27:

- We optimized the 1756-CNB(R), version 5.27, for the ControlLogix Redundancy system. Please use this compatibility table when implementing ControlLogix redundancy. Refer to the latest ControlLogix Redundancy Release Notes for the most up to date compatibility chart.

Product	Minimum requirement for redundancy
RSLogix5000	Version 8.52.00
RSLinx	Version 2.30.01
RSNetWorx	Version 3.00.02
1756-CNB(R)	F/W version 5.27
1757-SRM	F/W version 2.15
Logix5555 Processor	F/W version 8.78

8 ControlLogix ControlNet Interface Module

- We added the ability to present diagnostic information on the 4-char display on the module. This information can now be displayed:

Display	Description	
n C ##	## indicates the total number of open connections Max = 64	
n U ##	## indicates the total number of unconnected buffer usage Max = 20	
% C ##	## indicates the module's CPU utilization percentage Max = 99%	
B x ##	## indicates the number of bandwidth exceeded occurrences since the last module reset Max = 99 Note: This counter display is disabled until the module detects at least one bandwidth exceeded event	
K p ##	Keeper status	
	If ## equals:	The module is:
	Ov	Offline with valid keeper information
	Oi	Offline with invalid keeper information
	Av	An active keeper
	Ai	An active Invalid keeper
	Iv	An inactive valid keeper
	Ii	An inactive invalid keeper

- We added 16-bit minor fault counters internal to the module for these fault conditions (this feature was introduced in version 5.22):
 - Bandwidth exceeded – increments whenever there are no ‘receive’ buffers available to handle incoming ControlNet data.
 - Network error count – increments whenever a ‘lonely’ or network mismatch condition is detected.
 - ControlBus receive error count – increments whenever the 1756-CNB module detects a backplane error on the module.

- ControlBus address error count – increments whenever the 1756-CNB module detects a backplane address error on the module.

These read-only counters are accessible to ladder programs using CIP generic messaging. These counters are continuous and will rollover from 65,535 to 0. The counts are reset only at module powerup.

The following is an example of how to set up a CIP Generic MSG to display these diagnostic counters. Fields that are not associated with any captions must be configured exactly as shown.

The screenshot shows a dialog box titled "Message Configuration - message" with three tabs: "Configuration", "Communication", and "Tag". The "Configuration" tab is active. The fields are as follows:

- Message Type: CIP Generic (dropdown)
- Service Code: 4f (Hex) (text box)
- Source: src_data (dropdown)
- Class name: a1 (Hex) (text box)
- Num. Of Elements: 6 (spin box) (Bytes)
- Instance name: 7 (text box)
- Destination: rcv_data (dropdown)
- Attribute name: (empty text box) (Hex)
- New Tag... (button)


Below the configuration fields are several radio buttons and checkboxes:

- Enable
- Enable Waiting
- Start
- Done
- Done Length: 0
- Error Code:
- Timed Out ←

At the bottom, there is an "Extended Error Code:" label followed by an empty text box, and four buttons: "OK", "Cancel", "Apply", and "Help".

Source Tag configuration: The source tag used in the above MSG instruction must be a User Defined Tag consisting of a DINT and an INT.

This figure shows what that User Defined data type looks like.

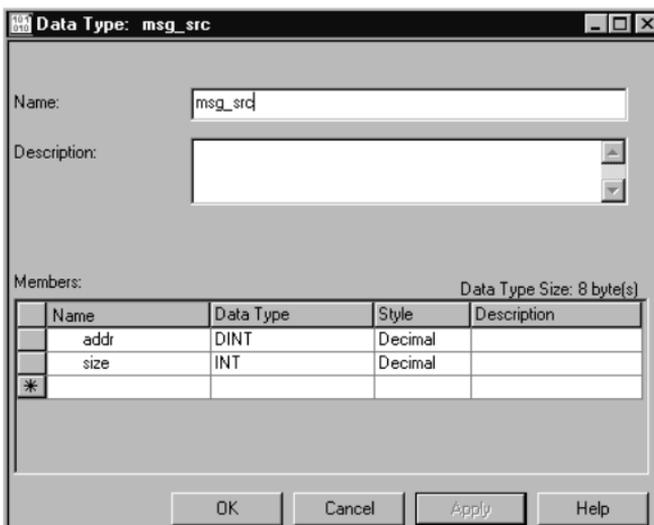

To display diagnostic counter information, the user must put the appropriate value that associates with the address of the diagnostic counter into the DINT portion of the source tag and the value associated with the size of the counter into the INT portion of the source tag. When the message is executed with the appropriate counter configuration, the assigned diagnostic counter value will be written to the destination tag (in the above example: rcv_data).

This table shows the address and size of each of these diagnostic counters.

Address	Size	Counter
00 00 00 0000	02	Bandwidth Exceed
00 00 00 0400	02	Network Error
00 00 00 0600	02	ControlBus Receive Error Count
00 00 00 0800	02	ControlBus Address Error Count

ControlLogix I/O Rack Connection Limitations

When using ControlLogix I/O with a remote ControlNet Adapter (1756-CNB or 1756-CNBR), as many as 5 controllers can create rack optimization connections to the ControlNet Adapter. All subsequent rack connection requests will fail.

It is possible that more than one ControlLogix controller can configure the same remote 1756-CNB module for rack optimization, since each RSLogix 5000 project configures the I/O for only one ControlLogix controller. As many as five ControlLogix controllers can communicate to the same 1756-CNB (or 1756-CNBR) module via a rack optimization connection. If more than five ControlLogix controllers configure the same 1756-CNB module for rack optimization, RSNetWorx for ControlNet software will schedule the network, but only five ControlLogix controllers will communicate to that 1756-CNB module. The RSLogix 5000 project files for the ControlLogix controllers that fail to communicate to that 1756-CNB module will show that 1756-CNB module as faulted, with the message, “16#011a Connection Request Error: Out of Connection Resources.”

Allen-Bradley, ControlLogix, RSLogix, Logix5550, RSView, and RSNetWorx are trademarks of Rockwell Automation.

ControlNet is a trademark of ControlNet International.

www.rockwellautomation.com

Corporate Headquarters

Rockwell Automation, 777 East Wisconsin Avenue, Suite 1400, Milwaukee, WI, 53202-5302 USA, Tel: (1) 414.212.5200, Fax: (1) 414.212.5201

Headquarters for Allen-Bradley Products, Rockwell Software Products and Global Manufacturing Solutions

Americas: Rockwell Automation, 1201 South Second Street, Milwaukee, WI 53204-2496 USA, Tel: (1) 414.382.2000, Fax: (1) 414.382.4444

Europe: Rockwell Automation SA/NV, Vorstlaan/Boulevard du Souverain 36-BP 3A/B, 1170 Brussels, Belgium, Tel: (32) 2 663 0600, Fax: (32) 2 663 0640

Asia Pacific: Rockwell Automation, 27/F Citicorp Centre, 18 Whitfield Road, Causeway Bay, Hong Kong, Tel: (852) 2887 4788, Fax: (852) 2508 1846

Headquarters for Dodge and Reliance Electric Products

Americas: Rockwell Automation, 6040 Ponders Court, Greenville, SC 29615-4617 USA, Tel: (1) 864.297.4800, Fax: (1) 864.281.2433

Europe: Rockwell Automation, Brühlstraße 22, D-74834 Elztal-Dallau, Germany, Tel: (49) 6261 9410, Fax: (49) 6261 17741

Asia Pacific: Rockwell Automation, 55 Newton Road, #11-01/02 Revenue House, Singapore 307987, Tel: (65) 351 6723, Fax: (65) 355 1733

Publication 1756-RN587G-EN-P - December 2004

PN 957944-42

Supersedes Publication 1756-RN587F-EN-P - September 2004 Copyright © 2004 Rockwell Automation. All rights reserved. Printed in the U.S.A.