


TERMINAL BOARD
USE ALLEN-BRADLEY TERMINAL BLOCK AND
JUMPERS AS INDICATED. MARK TERMINALS AS SHOWN.





480 VOLTS OR 600 VOLTS DELTA-208Y/120V
60 HERTZ WITH (2) 2-1/2% TAPS FCAN
AND (2) 2-1/2% TAPS FCBN

180°C INSULATION 80°C RISE
VACUUM IMPREGNATED VARNISH
NATURAL FINISH OVER ENTIRE TRANSFORMER

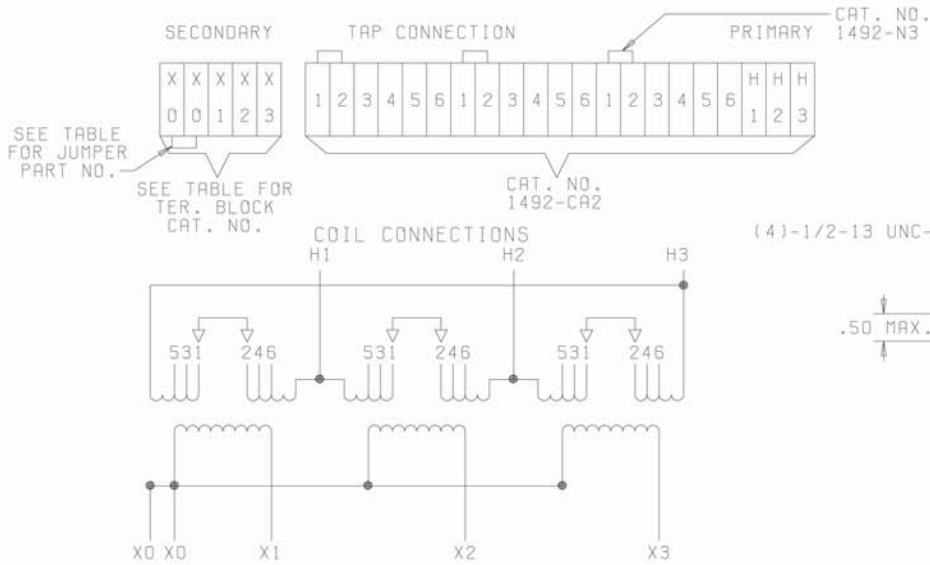

NOTE: 1) NAMEPLATE SUPPLIED BY VENDOR MUST INCLUDE THE FOLLOWING:
ALLEN-BRADLEY NAME, PART NUMBER, PRIMARY VOLTAGE,
SECONDARY VOLTAGE, KVA RATING, PHASE AND HERTZ.

- 2) MUST BE UL LISTED OR COMPONENT RECOGNIZED.
- 3) TERMINAL SUPPORT TO BE KEPT TO ±0.25 OF STRAIGHTNESS.
- 4) WELDED CORE ACCEPTABLE, DIMENSIONAL AND TEMPERATURE REQUIREMENTS MUST BE MET.

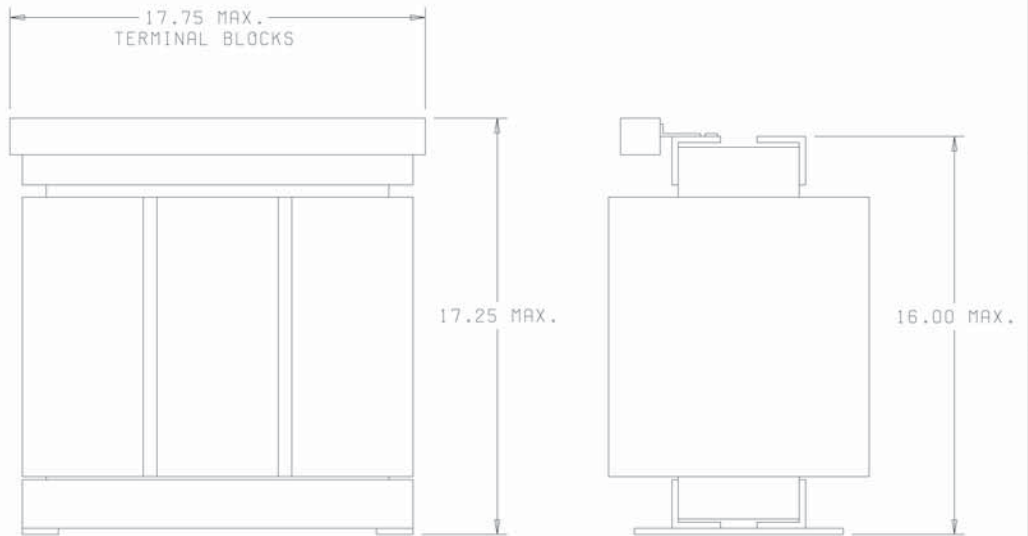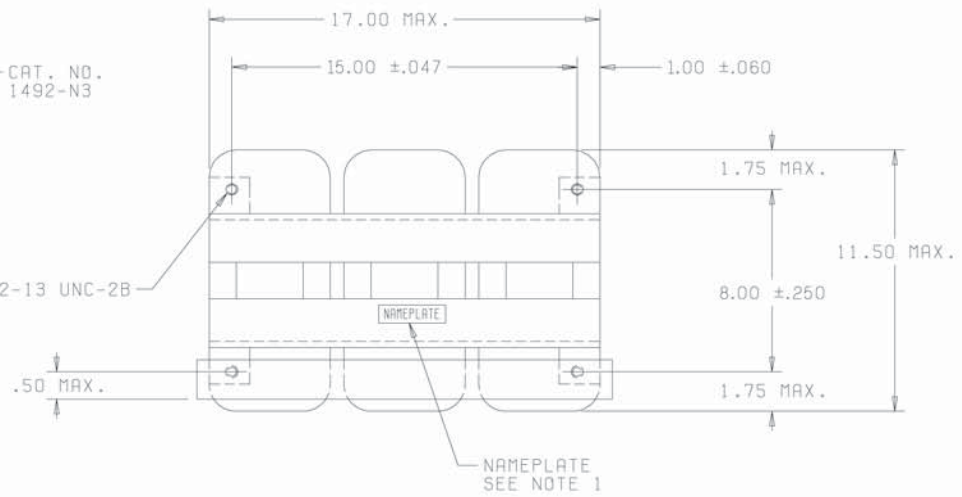

PARTS MUST CONFORM
TO APPLICABLE
ALLEN-BRADLEY CO.
WORKMANSHIP STANDARD
40126-700

-10	G	30	600	1492-CE2	1492-N21
-09	G	25	600	1492-CE2	1492-N21
-08	G	20	600	1492-CE2	1492-N21
-07	G	15	600	1492-CD2	1492-N3
-06	G	10	600	1492-CD2	1492-N3
-05	G	30	480	1492-CE2	1492-N21
-04	G	25	480	1492-CE2	1492-N21
-03	G	20	480	1492-CE2	1492-N21
-02	G	15	480	1492-CD2	1492-N3
-01	G	10	480	1492-CD2	1492-N3
PART NO.	CHG. LTR.	KVA	PRIMARY VOLTAGE	CAT. NO. OF TERM. BLOCKS	JUMPER PART NO.

TAP CONNECTION	VOLTAGE 480	VOLTAGE 600
1-2	504	630
2-3	492	615
3-4	480	600
4-5	468	585
5-6	456	570

REFERENCES	NONE	TRANSFORMER		cv 40022.052.R10.DCC
REVISION	RELEASE	THREE PHASE		 THIS DRAWING IS THE PROPERTY OF ROCKWELL INTERNATIONAL CORPORATION OR ITS SUBSIDIARIES AND MAY NOT BE COPIED, USED OR DISCLOSED FOR ANY PURPOSE EXCEPT AS AUTHORIZED IN WRITING BY ROCKWELL INTERNATIONAL CORPORATION
6	21214-93	DR. MERIWETHER	DATE 4-8-85	
7	21040-94	CHKD. N/A	DATE N/A	 40022-052
8	21403-95	APP.D.C. MALKOWSKI	DATE 9-23-85	
9	21067-97			
10	21299-01			